


SIZE	DWG NO. FP 01	DRAWN BY : GAYAN
		CHECKED BY :
	SCALE : 1 : 500	APPROVED BY :

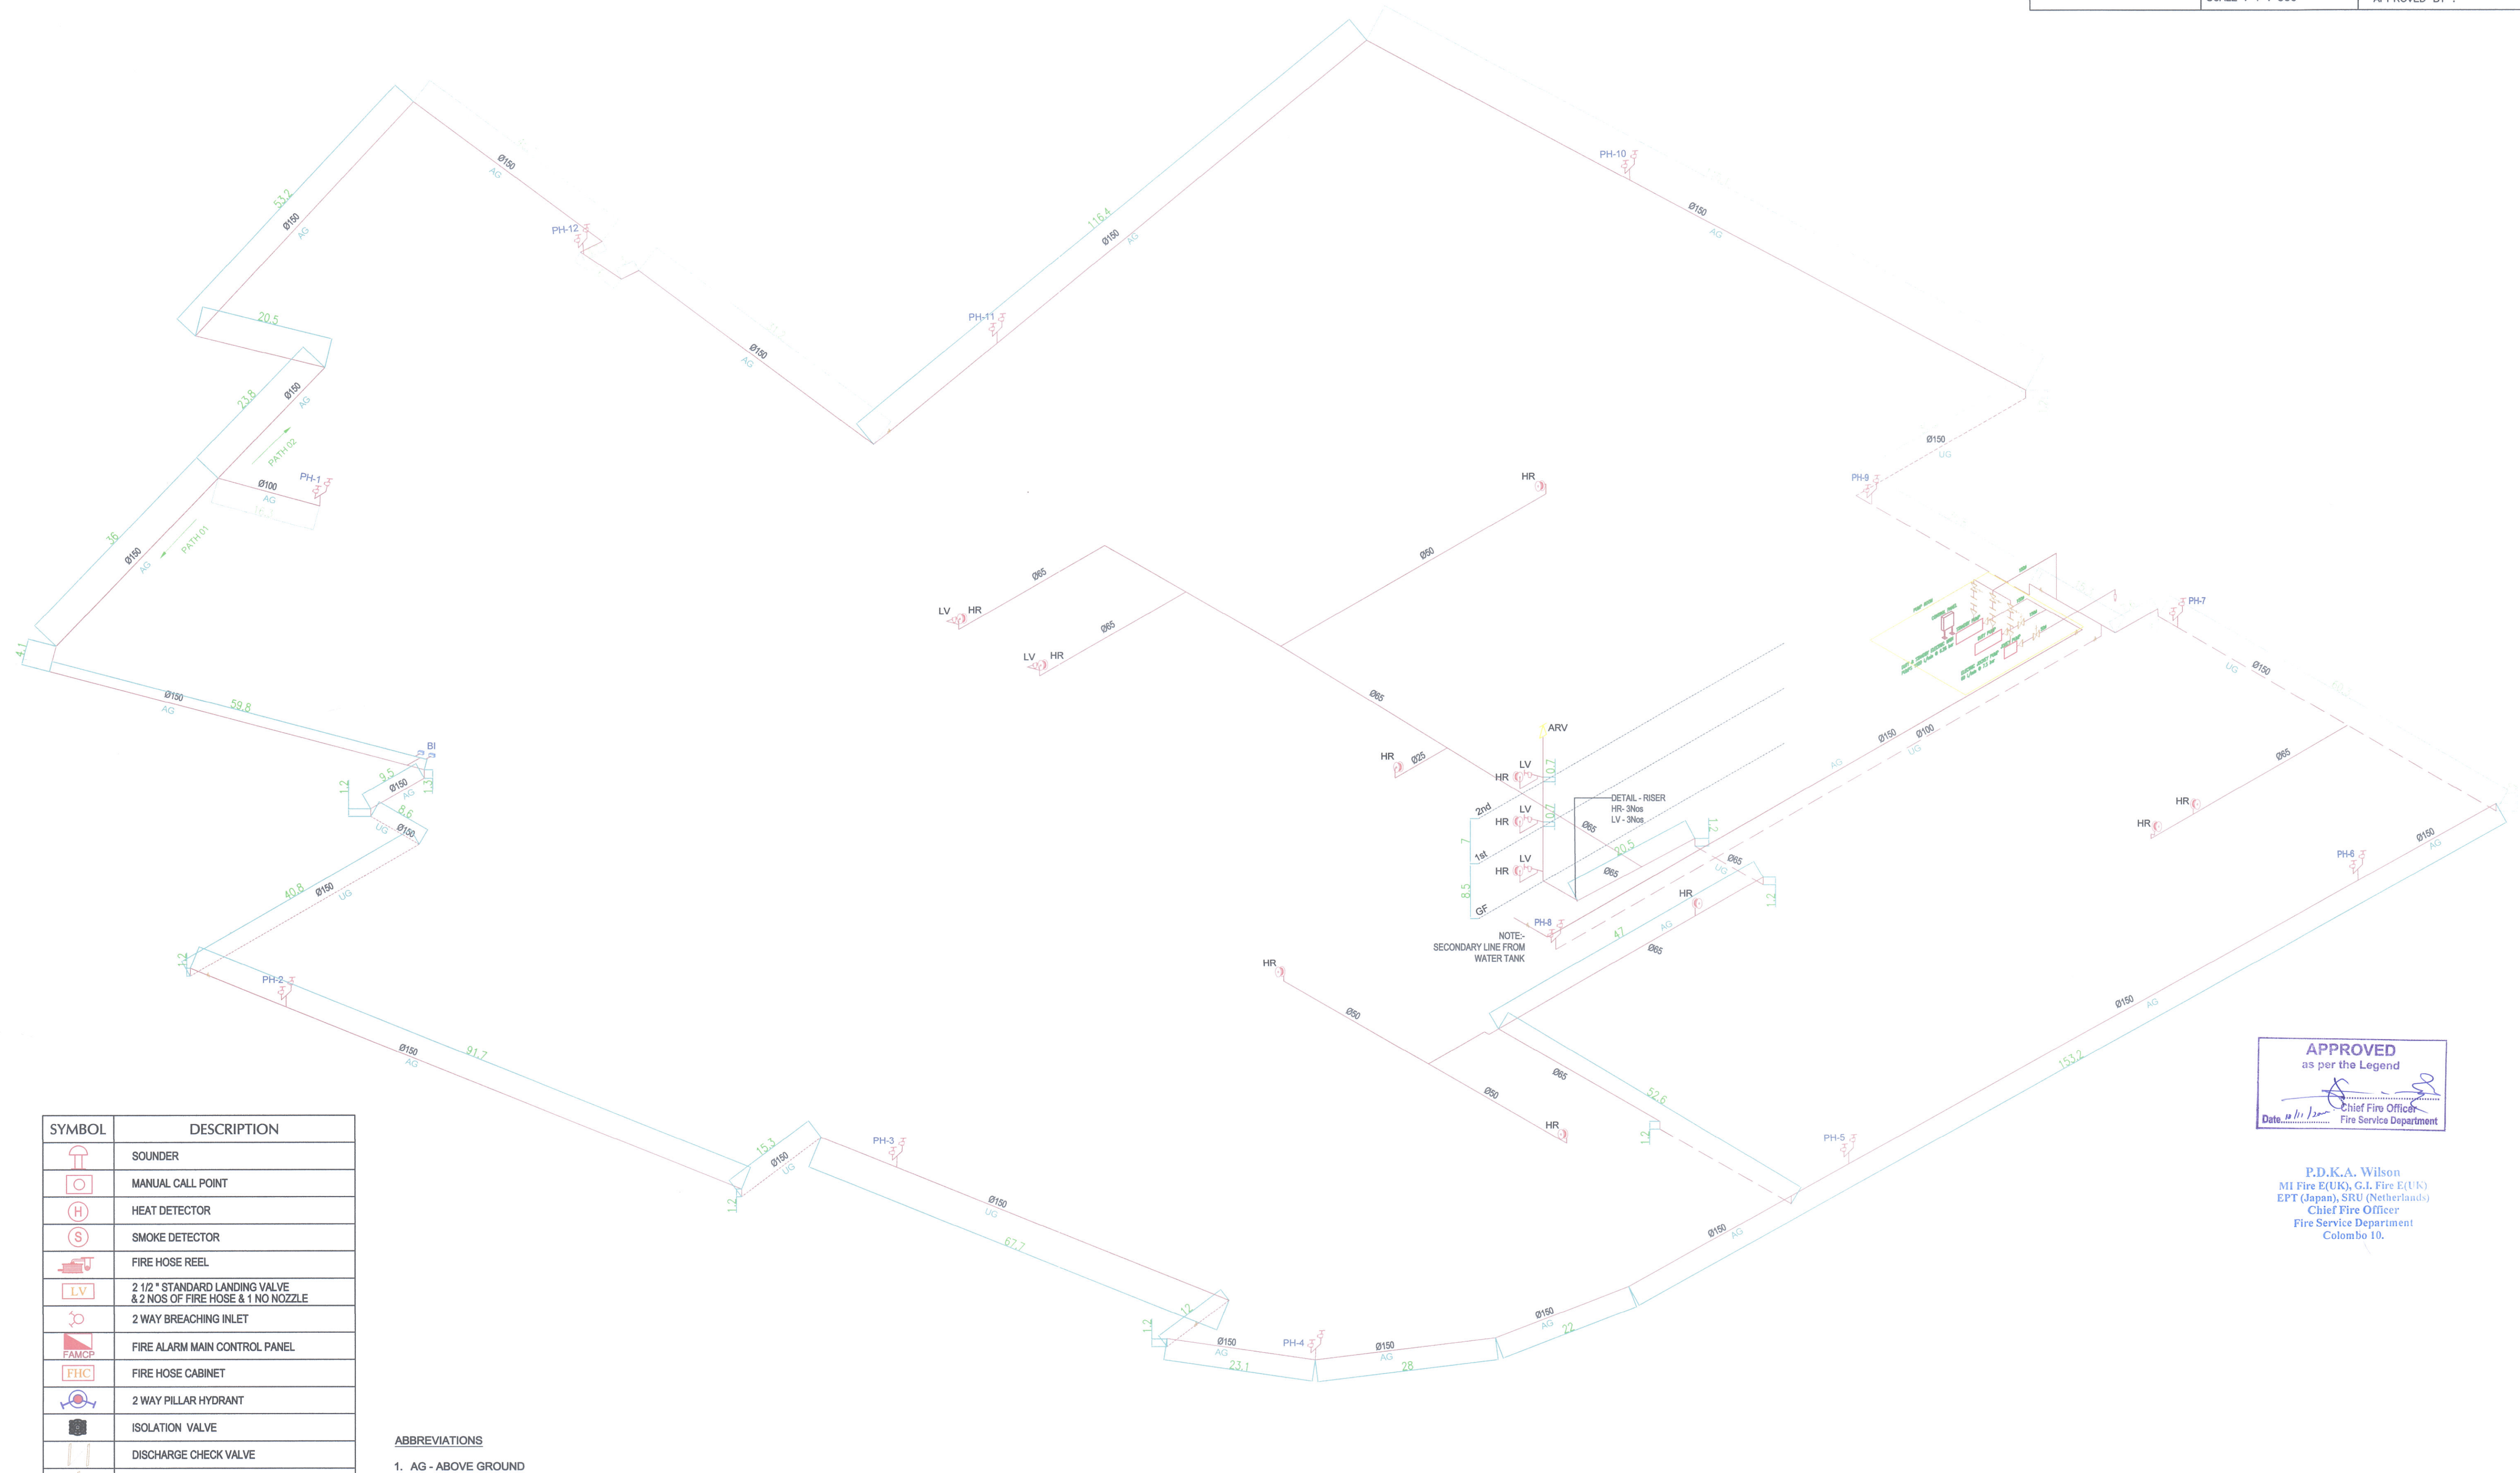

SYMBOL	DESCRIPTION
	SOUNDER
	MANUAL CALL POINT
	HEAT DETECTOR
	SMOKE DETECTOR
	FIRE HOSE REEL
	2 1/2" STANDARD LANDING VALVE & 2 NOS OF FIRE HOSE & 1 NO NOZZLE
	2 WAY BREACHING INLET
	FIRE ALARM MAIN CONTROL PANEL
	FIRE HOSE CABINET
	2 WAY PILLAR HYDRANT
	ISOLATION VALVE
	DISCHARGE CHECK VALVE
	FLEXIBLE CONNECTOR
	GATE VALVE

- ABBREVIATIONS**
- AG - ABOVE GROUND
 - UG - UNDER GROUND
 - PH - PILLAR HYDRANT
 - LV - LANDING VALVE
 - HR - FIRE HOSE REEL
 - GOP - CENTER OF PIPE
 - FFL - FLOOR FINISH LEVEL

**FACTORY GROUND FLOOR ISOMETRIC
VIEW**

APPROVED
as per the Legend

Date: 11/1/2024
Chief Fire Officer
Fire Service Department

P.D.K.A. Wilson
M1 Fire E(UK), G.I. Fire E(UK)
EPT (Japan), SRU (Netherlands)
Chief Fire Officer
Fire Service Department
Colombo 10.